
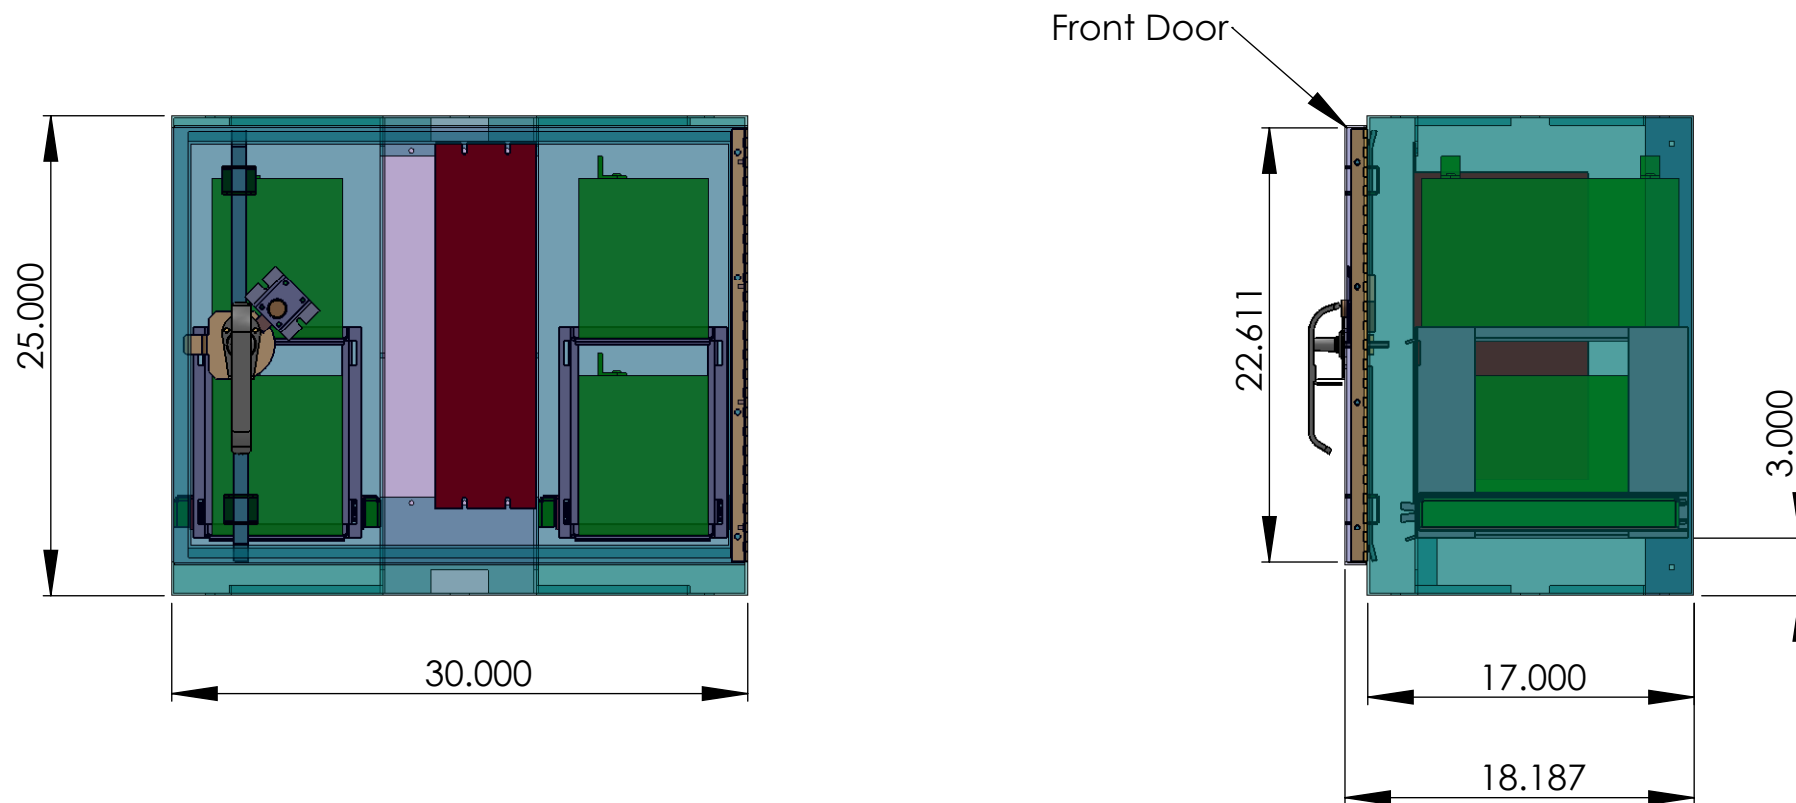


| REV | DESCRIPTION | DRN | DATE: |
|-----|-------------------------------|-----|----------|
| A | Original | DM | 08-04-10 |
| B | Height was 24", Added Details | DM | 08-09-19 |
| | | | |

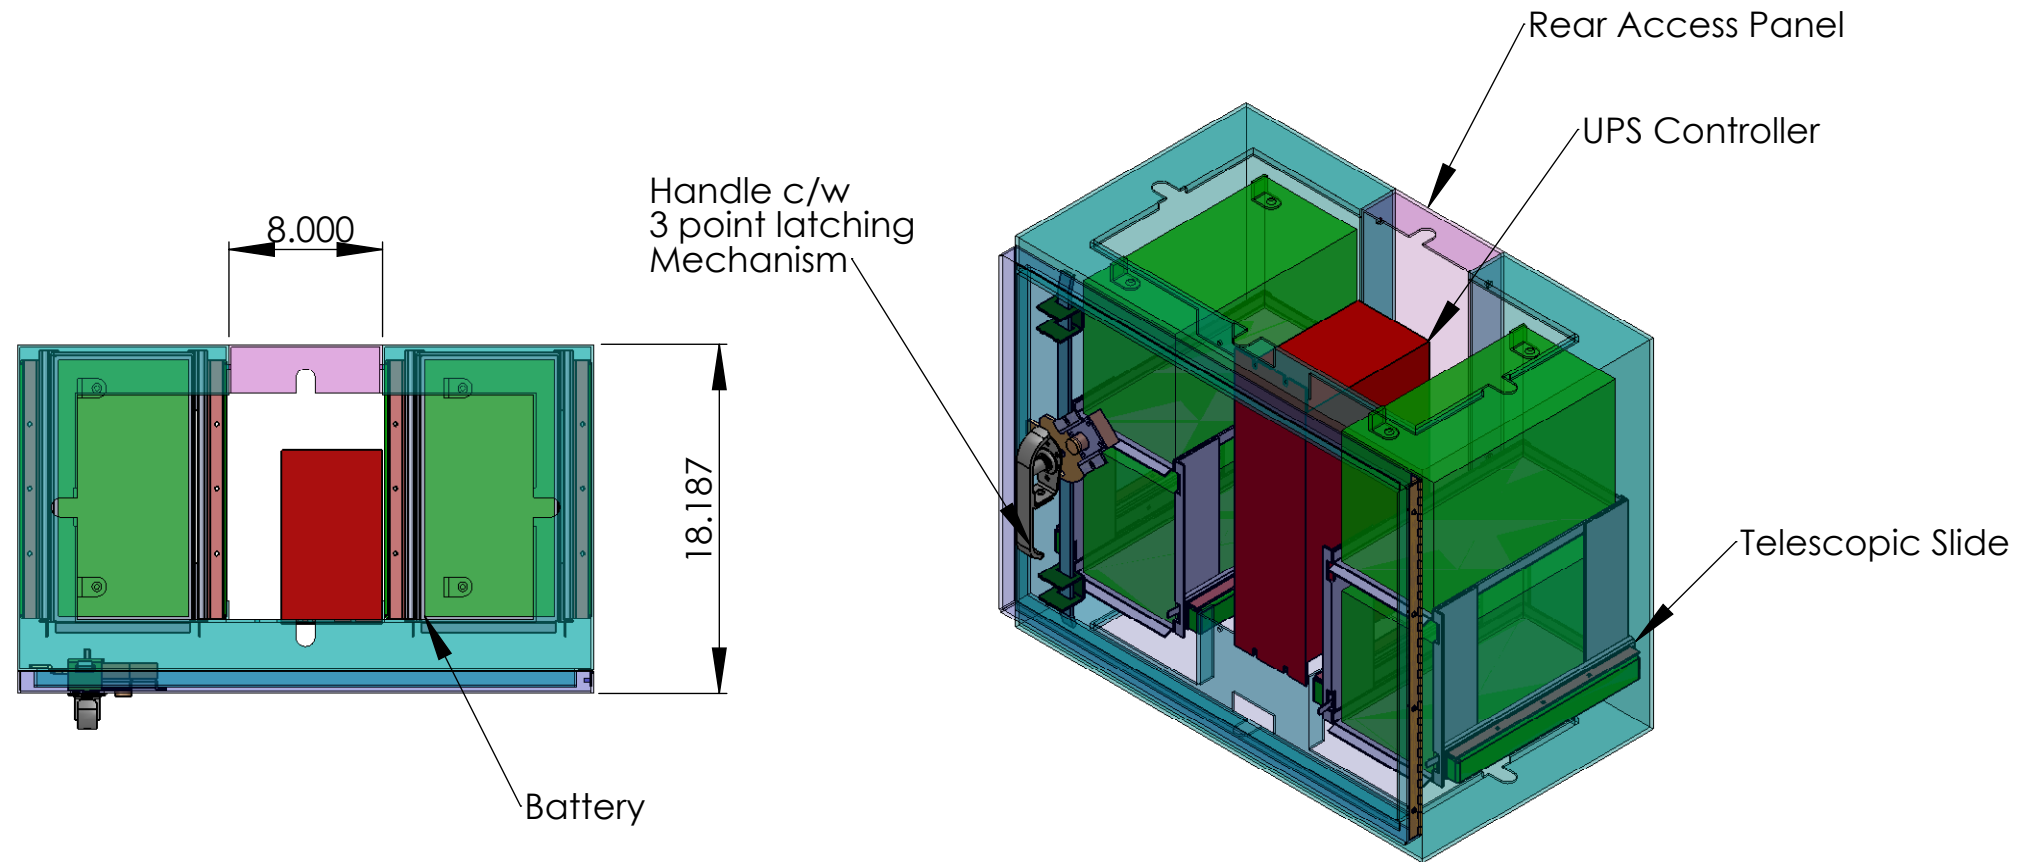

Notes:

- 1) UPS Pedestal is designed to add UPS to an existing NEMA Type M cabinet installation.
- 2) UPS Controller is an Alpha Novus FXM 1100
- 3) Batteries are standard Alpha-Cell 180 GXL. Heater pads are under batteries ensure operation in cold weather. Protective caps are placed over the battery terminals.
- 4) Battery shelves are mounted on slide rails for easy access to the batteries.
- 5) Lock is keyed for standard traffic controller cabinets.
- 6) Locating batteries in the pedestal results in lower infrastructure costs for installation.
- 7) The clearance between the battery tray to the base is 3 inches
- 8) All Dimensions are shown in inches.

| | | | |
|---|-------|----------|--|
| APPROVAL | INIT. | DATE | NOVAX INDUSTRIES CORP. NEMA Type M Cabinet Retrofit UPS Pedestal |
| AUTHOR: | DM | 08-04-10 | |
| CHECKED: | | | |
| APPROVED: | | | |
| <small>This drawing and information contained therein is confidential information which is protected by copyright (2008). No part may be reproduced, transcribed into any language or computer language, or transmitted in any form. The recipient will not use or disclose the contents to any third party without prior written consent of Novax Industries Corp.</small> | | | Old Drawing No: - New Drawing No: NDWG000049 SHEET 1 OF 1 |
| | | | REV.: B SCALE: SIZE: B |